


# Networking Closet UPS Part List

## Parts List

- **UPS:** Vertiv Liebert GXT5 UPS - 1500VA 1350W
  - Manufacturer Number: GXT5-1500LVRT2UXL
  - CDW Number: 5610548
- **NIC (Installed in UPS):** Vertiv Liebert Intellislot RDU101
  - Manufacturer Number: RDU101
  - CDW Number: 5606456
- **PDU:** Panduit G5 Basic PDU
  - Manufacturer Number: P12B01M
  - CDW Number: 5733445
- **Expanded Battery Pack:** Liebert GXT5 Battery Enclosure
  - Manufacturer Number: VRT-GXT5-EBC48VRT2U
  - CDW Number: 5616676
- **Power Switcher:** Liebert MicroPod Bypass Switch
  - Manufacturer Number: MP2-115A
  - CDW Number: 847093

## Installation Diagram

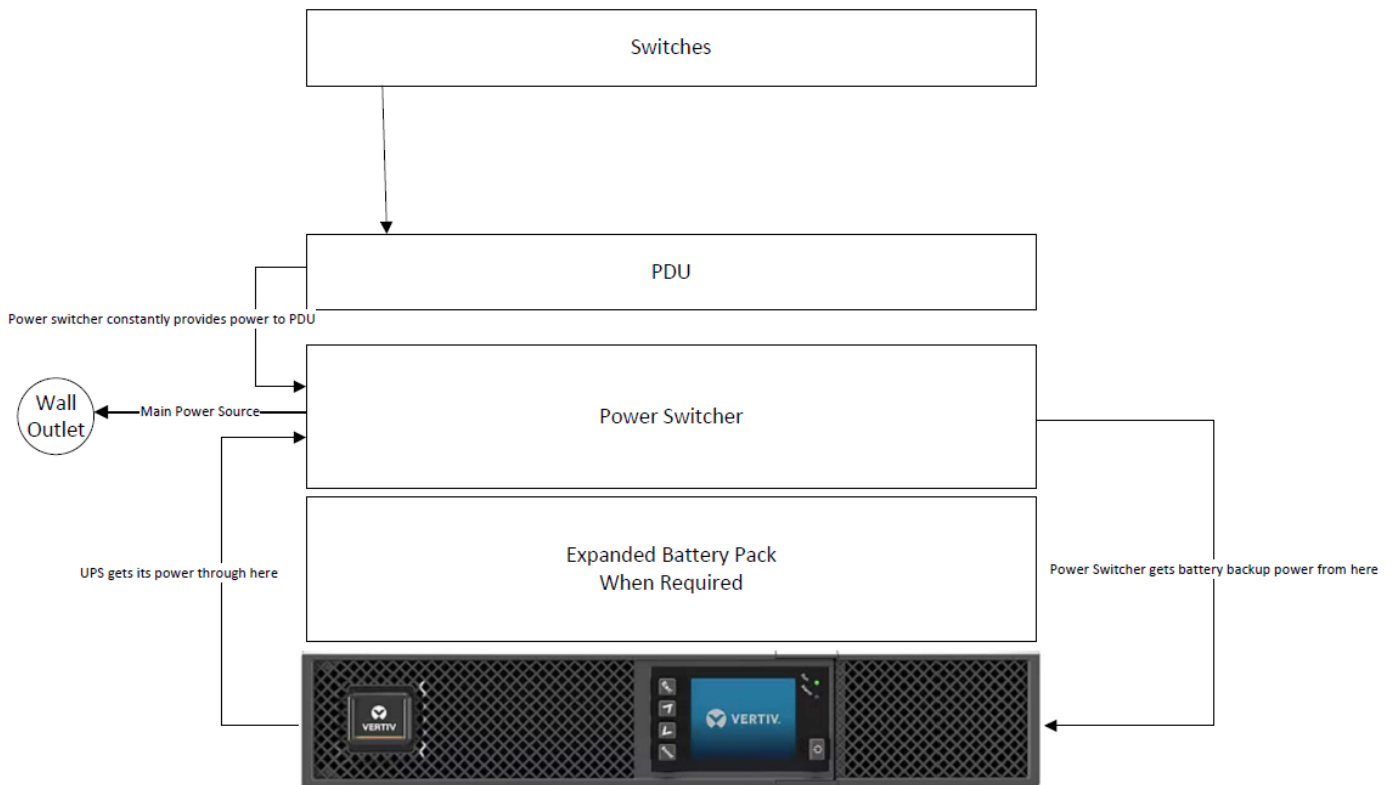

# Exceptions

This is the equipment for a standard rack-mounted UPS installation. Certain installations will require less or different equipment.

- In non-rack environments or in small racks not running from the floor, instead utilize a 2U Eaton Tripp Lite UPS
  - Manufacturer Number: SMART1500LCD
  - CDW Number: 892647
- If a pre-existing UPS installation doesn't have an extended battery enclosure, it can be assumed the replacement installation doesn't require an extended battery enclosure.
- Some installations have enough connected devices to necessitate more than one PDU. The listed PDU includes 12 ports, so in installations with more than 12 devices requiring power an additional PDU should be ordered.

---

Revision #1

Created 9 April 2025 18:22:55 by Joseph Park

Updated 9 April 2025 19:14:34 by Joseph Park